


Kerite Cable Services Project Profile

Project	Amos Plant/AEP- 138kV Line Repair
Client	American Electric Power
Location	Winfield, WV
Cable Design	138 kV, 750 kcmil CU
Length	1,400 Linear Feet
Scope	Prime contractor for the new installation/repair for two phases of a 138kV circuit. Customer pulled two 700ft lengths. KCS technicians installed 4- G&W PAT-140 polymer terminations and completed final acceptance testing.



Pulling the new cable in the substation duct bank.

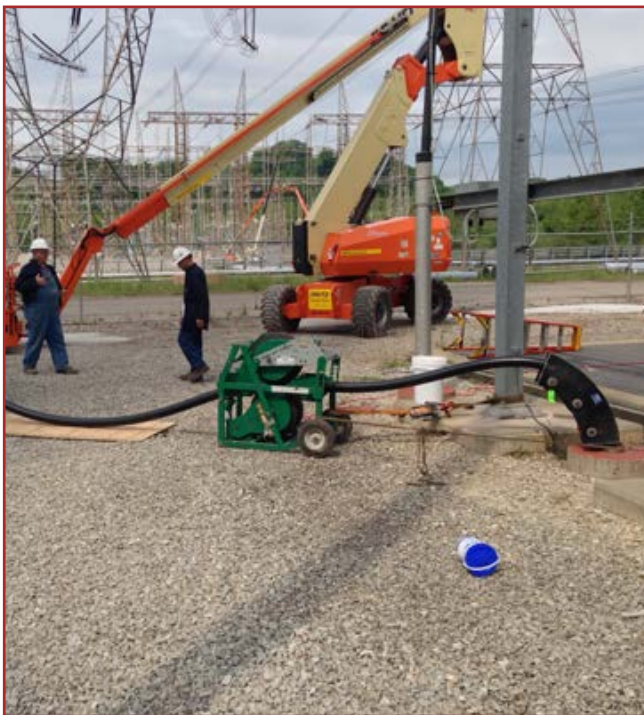

Completed G&W PAT-140 terminations.